

## Project Details

<b>Project Name</b>	
<b>System Name</b>	Flowcoat CR (Light Non Slip Finish)

## Architectural Specification

### Flowcoat CR


High performance, lightly textured, hard wearing epoxy resin coating which provides enhanced chemical resistance. Typically used in industrial environments which may be subjected to chemical spillages.

<b>Thickness</b>	0.35mm	
<b>Colour Choice</b>		
<b>Slip Resistance</b>	P3 (Based on 60 Mesh White Aluminium Oxide Aggregate)	
<b>Fire Resistance</b> AS/ISO 9239.1	CHF Value	> 11 kW/m <sup>2</sup>
	Smoke Value	<5% (Mean)
<b>VOC Content</b> ASTM D2369-10: 2015	< 140 g/L	
<b>Finish</b>	Gloss - Light Non Slip	
<b>Curing</b>	Full Chemical Cure 7 Days @ 20°C	
<b>Traffic</b>	Vehicular Traffic 72hrs @ 20°C	
<b>Manufacturer</b>	Tremco CPG Australia Pty Ltd	
<b>Address</b>	63 Radley Street	
<b>Suburb</b>	Virginia	
<b>State / Post Code</b>	QLD 4014	
<b>Main Telephone</b>	+61 7 3205 7115	
<b>Main Email</b>	australia@flowcrete.com	
<b>Key Contact</b>		

### Products Included In This System

<b>Layer 1</b>	Flowprime NEW *If Required for porous surfaces only
<b>Layer 2</b>	Flowcoat CR
<b>Layer 3</b>	Flowcoat CR
	Aluminium Oxide

### System Design

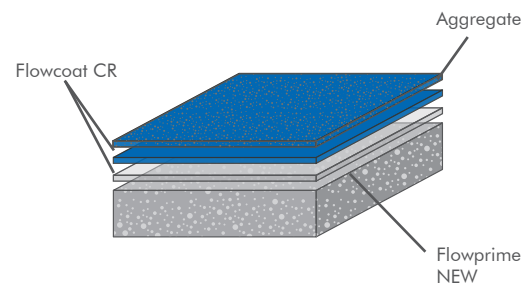

### Available Colours



The applied colours may differ from the examples shown.  
For a full colour chart and samples, contact your local Flowcrete office.

## Substrate Requirements

Concrete or screed substrate should be a minimum of 25 N/mm<sup>2</sup>, free from laitance, dust and other contamination. Substrate should be dry to 75% RH as per ASTM F2170 (AS1884:2012). Slab on ground concrete must have an effective damp proof membrane in place.

## Surface Preparation

Concrete should be finished by steel trowel. Surface preparation is to be completed by totally enclosed light shot blasting (please note this may leave track and blast lines which will not be covered) or diamond grinding. All cementitious laitance must be removed to expose a sound substrate and provide a dry, dust free, open textured surface. All hard to reach areas and areas around the perimeter must be prepared using hand held preparation equipment.

Any damaged areas must be repaired with Flowtex F1 mortar. Consult Flowcrete prior to using an alternative repair mortar. Any rough or uneven areas must be made smooth with Flowcoat SC (Universal Resin Base A, Universal Hardener B, Sand/Flour).

## Cleaning

For specific cleaning and maintenance requirements, please consult our Technical Advisory team on 07 3205 7115 or email [australia@flowcrete.com](mailto:australia@flowcrete.com).

## Important

This specification assumes a concrete compressive strength greater than 25 N/mm<sup>2</sup>, application and curing temperatures of 5–35°C, the presence of an effective damp proof membrane below substrate and concrete moisture content less than 75% RH. If moisture content is above 75% RH, please contact Flowcrete Australia.

This specification must be read in conjunction with relevant product technical data sheets and the application of all materials is to be strictly in accordance with manufacturer's instructions.

## Note

When printed or saved externally, this document is uncontrolled and therefore may not be the latest version. Any recommendation or suggestion relating to the use of the products made by Tremco CPG Australia Pty Ltd., whether in its technical literature, or in response to a specific enquiry, or otherwise, is based upon data believed to be reliable, however the products and information are intended for use by Customers having requisite skill and know-how in the industry and therefore it is for the Customer to satisfy itself of the suitability of the products for its own particular use and it shall be deemed that the Customer has done so at its sole discretion and risk.

This specification must be read in conjunction with relevant product technical data sheets and the application of all materials is to be strictly in accordance with manufacturer's instructions.